


Tarra River Water Supply System

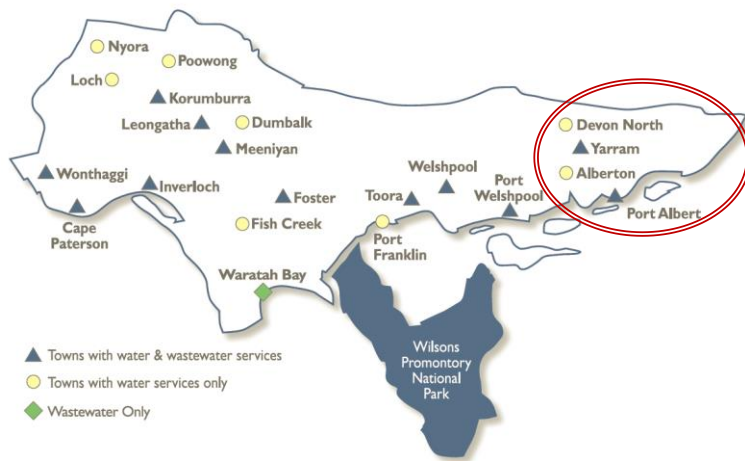

The Tarra River Water Supply System supplies water to the townships of:

- Yarram;
- Alberton;
- Port Albert; and
- Surrounding rural communities.

Primary supply is from a diversion weir on the Tarra River, with backup supply from a groundwater bore. Both sources of water are transferred to a storage basin, with a capacity of 31 ML. This storage allows water supply to be maintained during short periods of low river flow during drought.

South Gippsland Water
 1300 851 636
www.sgwwater.com.au


Water Supply Information

Water resources held by South Gippsland Water for the Tarra River Water Supply System are shown below. Only 15% of the available annual entitlement has been used from the Tarra River in the current year to date (Jul-Oct 2017), with 1% of the annual groundwater bore entitlement used over the same period. This entitlement is a legal right to access water, subject to availability.

Water Component	Maximum Annual Entitlement	Volume Extracted 2017-18	Volume Remaining 2017-18
Tarra River	853 ML	129 ML	724 ML
Groundwater Bore	214.2 ML	2.2 ML	212 ML

Water Consumption

Monthly water consumption for the Tarra River Water Supply System in the year to date has been close to or above the average demand over the last five years.

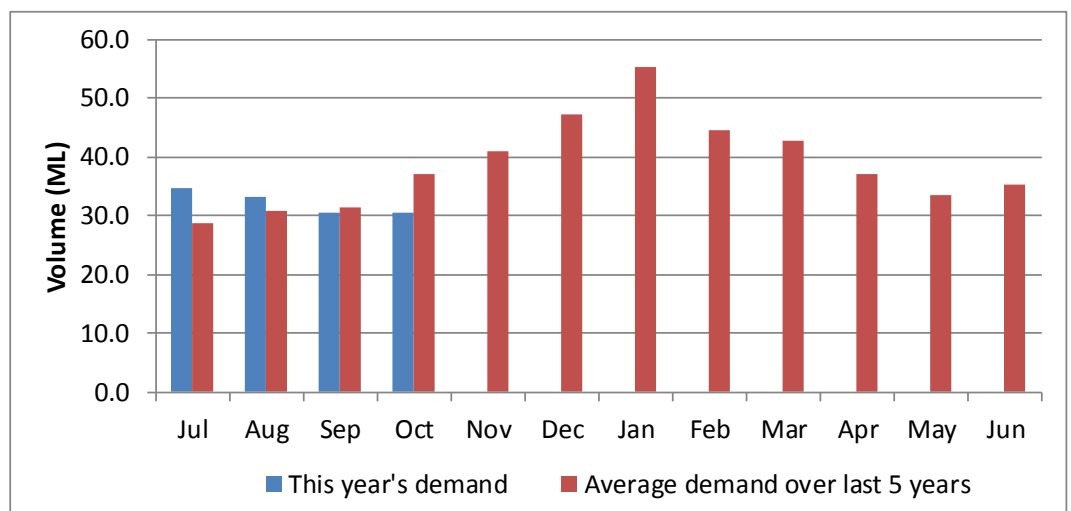

Further Information:

- The most recent records for the Tarra River upstream of the diversion weir show that it was flowing at an average of 10 ML/d during October. This is above the 5 ML/d flow threshold to activate groundwater pumping, which is used to deal with water shortages, but is still a relatively low flow (exceeded in 92% of Octobers).
- The Yarram storage basin was 100% full at the end of October.
- Unregulated river flows are difficult to forecast. SGW has only forecast the next 3 months due to low forecast skill beyond 3 months. The graph is formatted to highlight low flow behaviour.
- Units are in megalitres per day (ML/d), where 1 ML is equivalent to 1 million litres (or roughly one Olympic sized swimming pool).


Climate Conditions

Forecast climate conditions for the coming three months have considered the Bureau of Meteorology’s seasonal climate forecast for the region and local climate conditions in the year to date. The Bureau’s climate outlook indicates that rainfall over the next three months is likely to be similar to the long-term average. Winter/spring rainfall in the year to date has been average to slightly below average. Air temperature is forecast over the next three months to be higher than the long-term average for this time of year, but any increase in demands from these higher temperatures is likely to be moderated by the anticipated rainfall. After taking these factors into account, South Gippsland Water is forecasting on the basis of an average climate scenario, which is characterised by streamflows in the Tarra River that are similar to long-term average values.

Chance of Exceeding Median Rainfall	Chance of Exceeding Median Maximum Temperature	This Year’s Spring Rainfall	Likely Outlook Scenario
60-65%	70-75%	Average	Average

Streamflow Outlook

Streamflows in the Tarra River are naturally highly variable, but were generally below average in the current year period, reaching a record low for the month of July. Whilst precisely forecasting streamflow conditions is difficult, streamflows for the outlook period are currently expected to remain below average if the climate conditions continue as expected. However, the forecast streamflow conditions are expected to remain above the threshold for groundwater pumping.

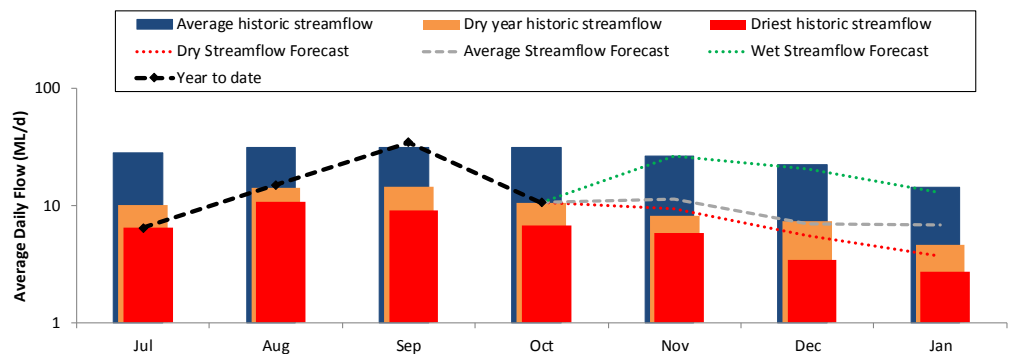

- Units are in megalitres per day (ML/d), where 1 ML is equivalent to 1 million litres (or roughly one Olympic sized swimming pool).

Urban Water Restrictions Outlook

Based on the streamflow outlook, the demands for water in the year to date, and the Bureau of Meteorology climate forecast, no water restrictions are anticipated for the remainder of the year at the current time. South Gippsland Water’s Permanent Water Savings Plan applies to all customers over the outlook period.

Climate Scenario	Outlook		
	1 Dec 2017	1 Jan 2018	1 Feb 2018
Wet	PWSP	PWSP	PWSP
Average	PWSP	PWSP	PWSP
Dry	PWSP	PWSP	PWSP

PWSP Permanent Water Savings Plan

Action Plan

A list of priority actions for this supply system is presented below. Further information on actions can be found in the Urban Water Strategy published in 2017 and Water Plan 3 publications on our website. The next phase of our Water Plan and Pricing Review is currently underway.

Action Name	Timing
Demand management	Ongoing
Reduce leaks and wastage	Ongoing
Continue purchase of groundwater licences as required	Ongoing
Update water security outlook	Every November

The information provided in this water security outlook is intended as a guide only. An update will be issued if conditions change during the outlook period.