


SCHEDULE OF ITEMS			
ITEM NO.	DESCRIPTION	ITEM NO.	DESCRIPTION
1	20mm / 25mm TAPPING BAND	8	BACKFLOW PREVENTION DEVICE (LOW HAZARD NON-TESTABLE) REFER TO ITEM 7
2	20mm / 25mm BALL VALVE RELEVANT WATER BUSINESS MAY UTILISE A FERRULE & BEND IN SOME CASES	9	ELBOW
3	ALL POLYETHYLENE PIPE & FITTINGS MUST BE WATERMARK APPROVED PIPE TO BE PN12.5 MINIMUM	10	TIMBER STAKE
4	POLYETHYLENE TO COPPER CONNECTOR	11	HOSE BIB TAP
5	DEPTH - MINIMUM COVER AUST. STANDARD AS/NZS 3500.1 (CLAUSE 5.10 & 5.11) AND LOCAL COUNCIL REQUIREMENTS	12	HOSE CONNECTION VACUUM BREAKER
6	20mm / 25mm RIGHT ANGLE BALL VALVE	13	TUBE BUSH
7	20mm / 25mm APPROVED WATER C SUPORPORATIONPLIED WATER METER THE TYPE OF WATER METERS (20mm AND 25mm) PROCURED BY THE WATER CORPORATION MAY VARY. WHERE WATER METERS INCORPORATE INTEGRAL DUAL CHECK VALVES, PLUMBERS ARE TO MAKE THEIR OWN ASSESSMENT WHETHER TO FIT AN ADDITIONAL CONTAINMENT BACKFLOW PREVENTION DEVICE	14	BRASS PLUG
			<b>SEE GENERAL NOTES FOR FURTHER INFORMATION</b>

STANDARD LEGEND		
⊗	V	Valve
○	M	Meter
□	D.B.	Dirt Box
—	S.P.	Straight Piece
⊥	T.F.	Testing Ferrule
▭	L.S.	Line Strainer
⌌	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
⌌	S.C.V.T	Single Check Valve Testable
⌌	S.C.D.A.T.	Single Check Detector Assembly Testable

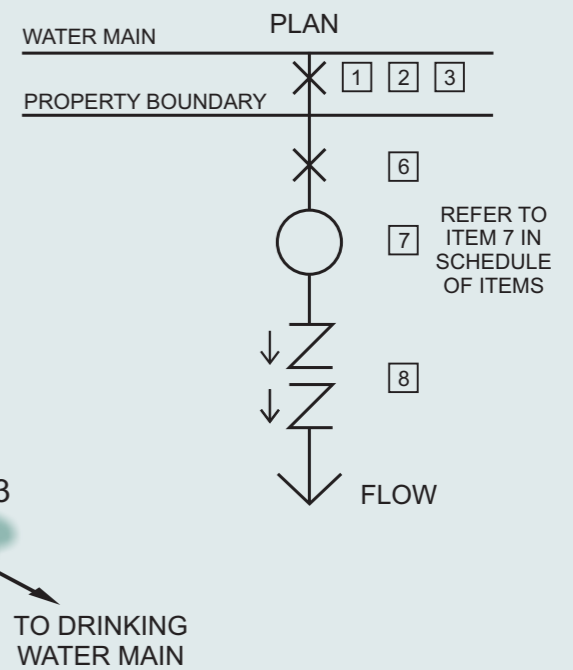

DRAWING NUMBER:

1

SCALE:

NOT TO SCALE

DATE:

SEPTEMBER 2012

20 - 25mm GENERAL WATER SERVICE (WET TAPPING)  
 LOW HAZARD  
 RESIDENTIAL / COMMERCIAL / INDUSTRIAL  
 TYPICAL ARRANGEMENT

