


ON FIRE SERVICES, ANY USE OF NON-METALLIC PIPE ABOVE GROUND IS RESTRICTED TO UPSTREAM OF THE LAST UPTURNED BEND ON THE RISER TO THE ASSEMBLY.
NOTE: USE OF GALVANISED WROUGHT IRON PIPE (GWIP) IS PROHIBITED IN ANY PART OF THE INSTALLATION UPSTREAM OF THE ASSEMBLY.

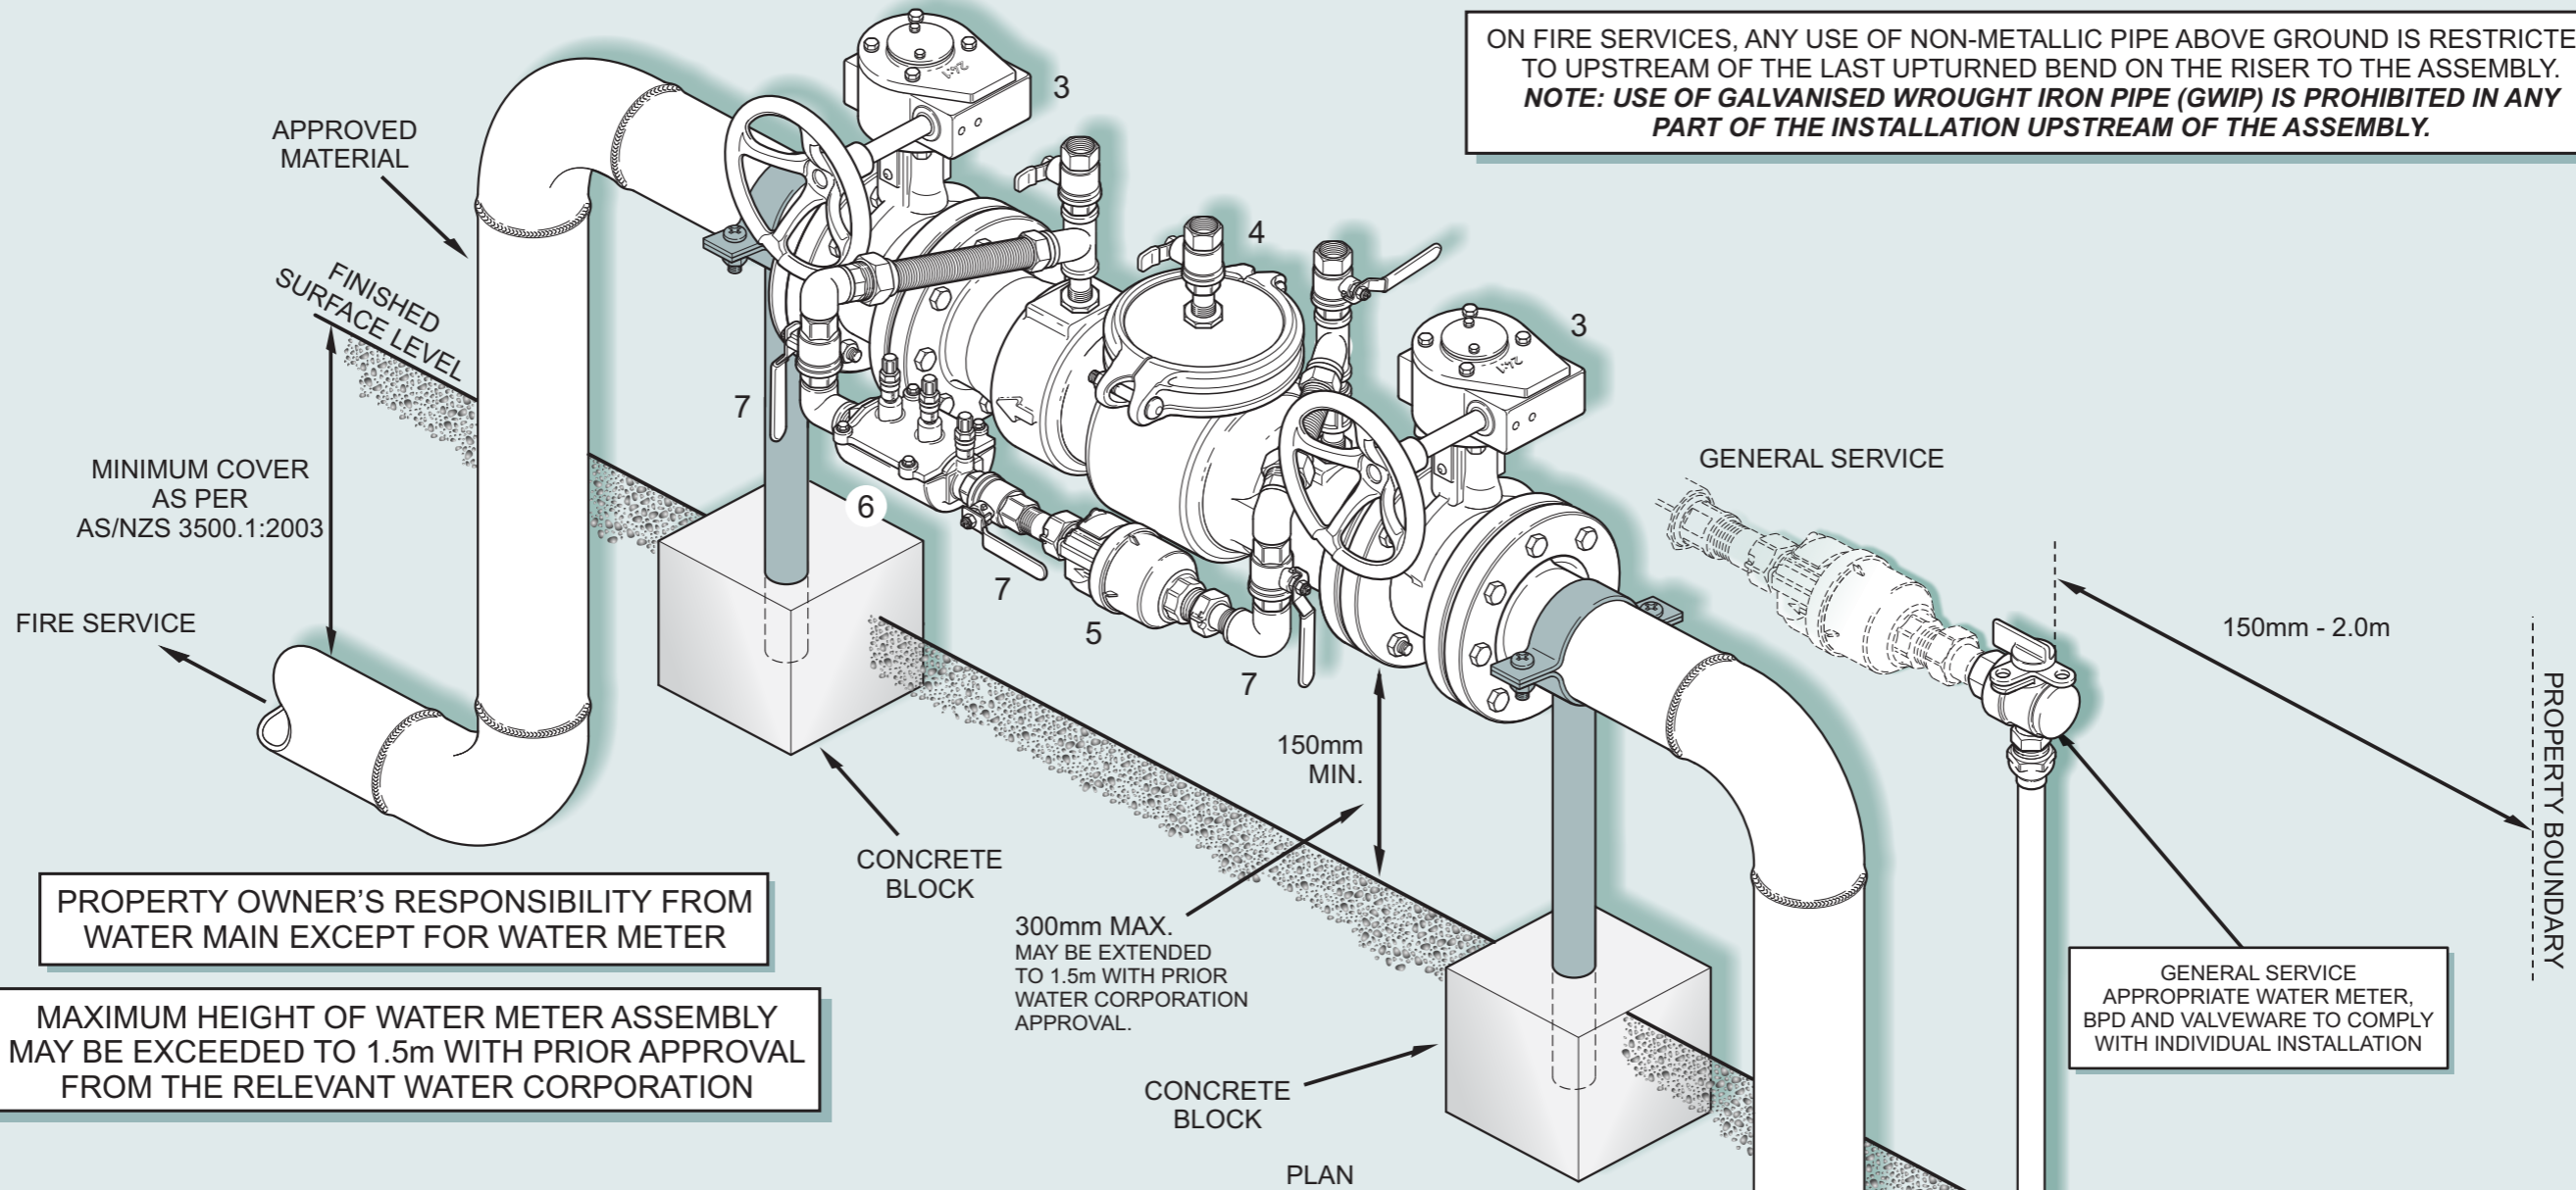


PROPERTY OWNER'S RESPONSIBILITY FROM WATER MAIN EXCEPT FOR WATER METER

MAXIMUM HEIGHT OF WATER METER ASSEMBLY MAY BE EXCEEDED TO 1.5m WITH PRIOR APPROVAL FROM THE RELEVANT WATER CORPORATION

SCHEDULE OF ITEMS	
ITEM NO.	DESCRIPTION
1 & 2	REFER TO DRAWING 17
3	ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE (RESILIENT SEATED)
4	DOUBLE CHECK DETECTOR ASSEMBLY TESTABLE. VALVE TO CONFORM TO AS/NZS2845
5	25mm BYPASS METER SUPPLIED BY WATER CORPORATION.
6	DOUBLE CHECK VALVE TESTABLE
7	LOCKABLE BALL VALVES WITH A003 KEYED LOCKS
SEE GENERAL NOTES FOR FURTHER INFORMATION	

STANDARD LEGEND		
⊗	V	Valve
○	M	Meter
□	D.B.	Dirt Box
—	S.P.	Straight Piece
⊥	T.F.	Testing Ferrule
▭	L.S.	Line Strainer
⌌	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
⌌	S.C.V.T	Single Check Valve Testable
⌌	S.C.D.A.T.	Single Check Detector Assembly Testable

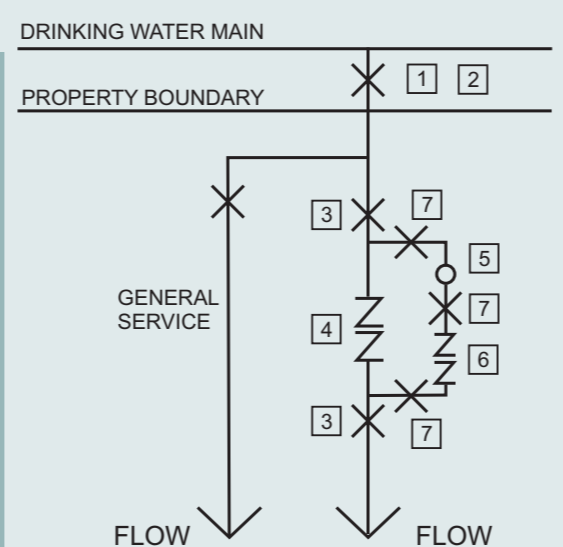

GENERAL SERVICE APPROPRIATE WATER METER, BPD AND VALVEWARE TO COMPLY WITH INDIVIDUAL INSTALLATION

1 & 2 TO WATER MAIN REFER TO DRAWING 17

DRAWING NUMBER:
10

SCALE:
NOT TO SCALE

DATE:
SEPTEMBER 2012

80mm+ FIRE HYDRANT / HOSE REELS WITH DOUBLE CHECK DETECTOR ASSEMBLY TESTABLE TYPICAL ARRANGEMENT

